

PYROSWISS® SBS (Smoke Barrier System)


Static smoke barrier system application with toughened fire resistant safety glass

CLASSIFICATION

DH = temperature/time classification for smoke barriers operating at higher temperatures (EN 1363-1) in conformance with EN 12101-1

SYSTEM DESCRIPTION

PYROSWISS® SBS (Smoke Barrier System) controls the movement of fire and hot smoke within buildings by forming a fixed, transparent high temperature barrier.

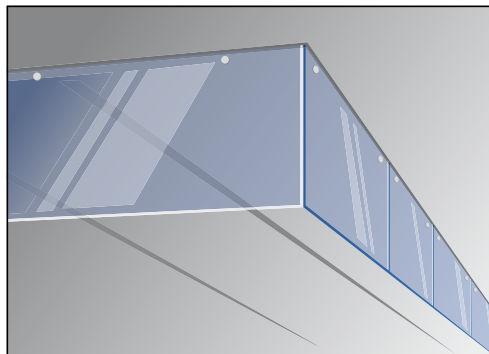

APPLICATIONS

- smoke reservoir boundaries
- channeling screens
- corridor containment
- escalator containment
- stairwell containment
- elevator containment

TECHNICAL SPECIFICATIONS

System name	PYROSWISS® SBS
Reaction to Fire (EN 13501-1)	A1
Application	Static fixed smoke barrier
Assessment No.	Efectis - France, 12-E-176
Fire resistance (EN 12101-1)	DH 30 and D ₆₀₀ 30 classification
CE certificate No. of conformity	0336-CPD-5064-E/06

TECHNICAL CHARACTERISTICS

Product Standard (Glass)	EN 14179
Nominal glass thickness	6 mm
Thickness tolerance	±0,2 mm
Width and length tolerance	±2 mm
Impact resistance (EN 12600)	1(C)1 classification
Transparence	Remains transparent in case of fire
Weight	15 kg/m ²
Light transmission (EN 410)	89%

FIELD OF APPLICATION

Fire protection	bi-directional
Fittings / brackets	Electro Galvanized steel or stainless steel
Supporting construction	Concrete or lightweight partition wall type 98/48 (or greater)
Maximum tested glass size	1500 x 1100 mm (W x H)
Minimal dimensions	Minimum production size
Number of holes per glass panel	2 holes (minimum)
Distance from hole to glass edge (W1)	100 mm ≤ W1 ≤ 375 mm
Maximum spacing between holes (W2)	750 mm
Gap at head (a to f)	10 mm
Gap at edge (g)	20 mm
Gap at intermediate joint (h)	5 mm


OPTIONS

	consult with your Vetrotech representative
	• Glass shapes • self-adhesive film


©2013 / subject to change without notice / August 2013 / version 2.0 INT en - type 03

PYROSWISS® SBS (Smoke Barrier System)


Static smoke barrier system application with toughened fire resistant safety glass

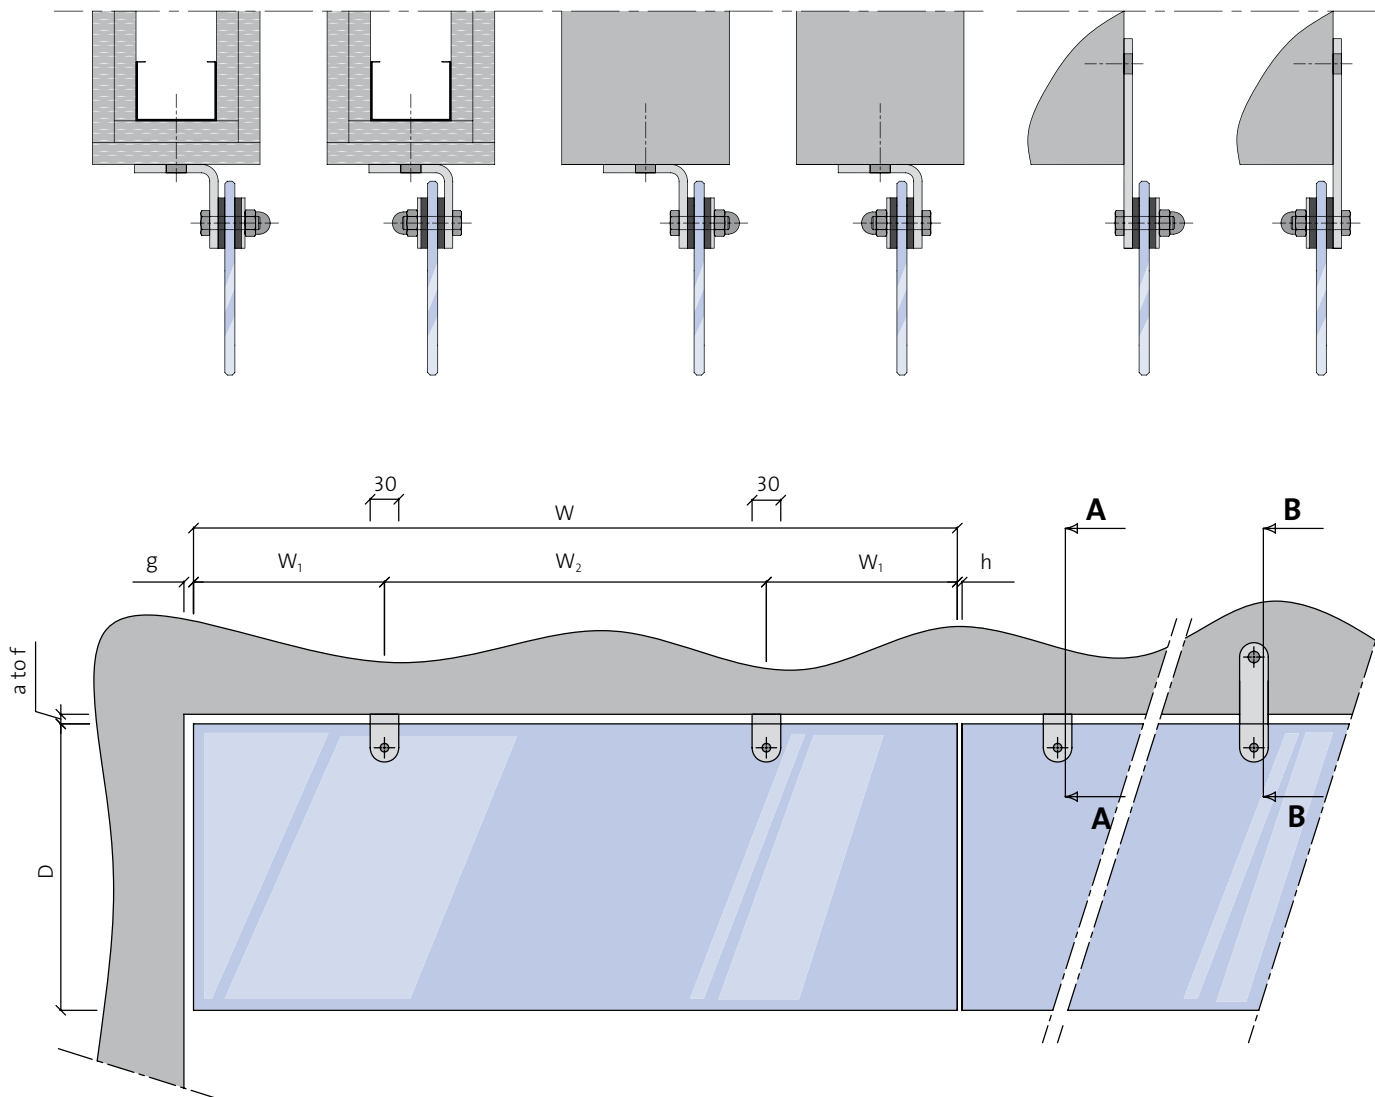

FIXING TYPES

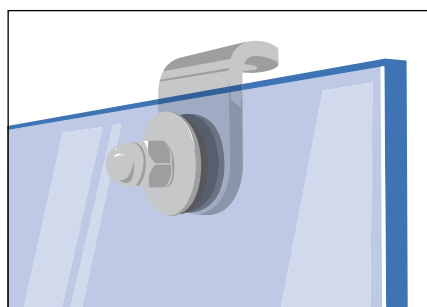

System «ECO»
Electrogalvanized steel fitting

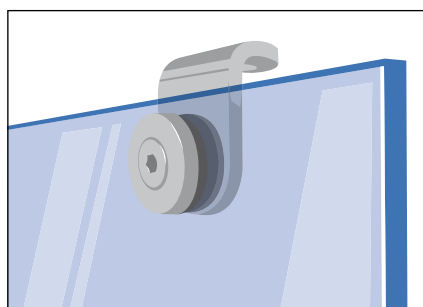

System «DESIGN»
Stainless steel fitting

W	≤ 1500 mm
D	≤ 1100 mm
W ₁	≥ 100 mm ≤ 375 mm
W ₂	≤ 750 mm
a to f	10 mm
g	20 mm
h	5 mm

Installation guidelines

PYROSWISS® SBS (Smoke Barrier System)



1 Verify that the supporting construction is level.



2 Locate the fixing points of the brackets on the supporting construction (concrete or lightweight partition).



3 Check the alignment of the brackets.



4 Verify that the brackets are level, shim as required.



5 Prepare the brackets placing the Chloroprene washers onto the bolts, (fasteners and washers are supplied with the kit).



6 Insert the Chloroprene grommets into the holes in the glass panels, then align over the fittings.



7 Holding the glass panel in place, assemble the outer Chloroprene washers and steel rings, then tighten securely.



8 Verify perimeter gaps (a to f) and alignment of the glass panels, adjust as necessary.

PYROSWISS® SBS (Smoke Barrier System)

Static smoke barrier system application with toughened fire resistant safety glass

Two standard fitting options

SYSTEM «ECO»
Electro Galvanized Steel



SYSTEM «DESIGN»
Stainless Steel



0336

Vetrotech Saint-Gobain International AG
Bernstrasse 43, CH-3175 Flamatt

12

0336-CPD-5064-E/06

EN 12101-1

Static smoke barrier, type SSB

Resistance to fire classification DH 30 and D₆₀₀ 30

Response delay NPD

Opening, gaps and perimeter spaces:

Gap_{head} (a to f) 10 mm

Gap_{edge} (g) 20 mm

Gap_{joint} (h) 5 mm

Area_{head} = W x Gap_{head} 15000 mm²

Area_{edge} = D x Gap_{edge} 22000 mm²

Area_{joint} = D x Gap_{joint} 5500 mm²

Area total = N1 x Area_{head} + N2 x Area_{edge} +

N3 x Area_{joint}

Maximum barrier permeability NPD

Tested at ambient temperature NPD

We Know Fire.

www.vetrotech.com